

# PLAZIT-POLYGAL INC.

## 16 MM SG (3-WALL) STORM PANEL INSTALLATION ANCHORAGE DETAILS

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED

**GENERAL NOTES:**

1. THIS PRODUCT HAS BEEN EVALUATED TO COMPLY WITH THE CURRENT PROVISIONS OF THE 7th EDITION (2020) FLORIDA BUILDING CODE (FBC) INCLUDING THE HIGH VELOCITY HURRICANE ZONE (HVHZ) AND IS BASED ON TESTING CONDUCTED TO TAS 202, TAS 201 & TAS 203 TEST PROTOCOLS PER TEST REPORT NO. NCTL-210-4125-01 BY NCTL, ORLANDO, FL.
2. ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE, MASONRY AND 2X FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
3. THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF THE INSTALLATION METHODS DEVIATE FROM THESE APPROVED DETAILS THIS WOULD REQUIRE FURTHER INVESTIGATION BY A LICENSED OR REGISTERED DESIGN PROFESSIONAL.
4. PER SECTION 2413 OF THE 7th EDITION (2020) FBC, ON ANY SIDE OF AN OPENING, THE MAXIMUM SIDE CLEARANCE BETWEEN THE SHUTTER AND A WALL OR INSET SURFACE SHALL BE 1/4 INCH. ANY DISTANCE IN EXCESS OF 1/4 INCH SHALL REQUIRE END CLOSURE OR SHUTTER OVERLAP, WHERE APPLICABLE. SHUTTER OVERLAP SHALL BE A MINIMUM OF 1.5 TIMES THE SIDE CLEARANCE BETWEEN THE SHUTTER AND WALL. THE INSTALLATION DETAILS SHOWN IN THIS PRODUCT APPROVAL DOCUMENT MEET THIS REQUIREMENT WHEN INSTALLED AS SHOWN.
5. PER SECTION 1709.9.3 OF THE 7th EDITION (2020) FBC, THE MANUFACTURER PRODUCT LABEL (EMBOSSSED OR PRINTED) SHALL BE SPACED NOT MORE THAN EVERY 3 LINEAL FEET ON EACH PANEL. THE LABEL SHALL BE APPLIED BY THE HOLDER OF THE PRODUCT APPROVAL AND SHALL FACE THE EXTERIOR OR OUTSIDE. THE LABEL SHALL INCLUDE THE INFORMATION REQUIRED BY SECTION 1709.9.2 OF THE 7th EDITION (2020) FBC.
6. MATERIALS: POLYGAL PANEL IS STANDARD GRADE POLYCARBONATE
7. ALL FASTENERS, NUTS AND WASHERS SHALL HAVE A CORROSION RESISTANT COATING OR BE STAINLESS STEEL.
8. PANELS ARE SHOWN INSTALLED VERTICALLY. THEY MAY BE INSTALLED HORIZONTALLY WHERE APPLICABLE.
9. MINIMUM PANEL SEPARATION TO GLASS MUST BE 2-3/4" BETWEEN PANEL AND WINDOW GLAZING OR FRAMING COMPONENTS. THE MINIMUM SEPARATION SHOWN INCLUDES THE 1 INCH MINIMUM SEPARATION AT MAXIMUM DEFLECTION WITH COMPONENTS OF FRAMES OF COMPONENTS REQUIRED BY SECTION 2413.2 OF THE 7th EDITION (2020) FBC.

**ANCHOR NOTES:**

1. SEE ANCHOR INSTALLATION CHART THIS SHEET FOR APPROVED ANCHOR TYPES, EMBEDMENTS, EDGE DISTANCES AND SUBSTRATES.
2. INSTALLATION ANCHOR CAPACITIES FOR PRODUCTS HEREIN ARE BASED ON SUBSTRATE MATERIALS WITH THE FOLLOWING PROPERTIES:
  - 2.1. WOOD - MINIMUM SPECIFIC GRAVITY OF 0.42 (NON-HVHZ) AND 0.55 (HVHZ).
  - 2.2. CONCRETE - MINIMUM COMPRESSIVE STRENGTH OF 2500 PSI.
  - 2.3. MASONRY - STRENGTH CONFORMANCE TO ASTM C-90 MEDIUM WEIGHT WITH MIN. COMPRESSIVE STRENGTH OF 1500 PSI OR 2000 PSI (SEE ANCHOR INSTALLATION CHART).

TABLE OF CONTENTS	
SHEET NO.	DESCRIPTION
1	GENERAL NOTES AND ELEVATION
2	ELEVATION AND ANCHOR LAYOUT
3-5	INSTALLATION DETAILS
6	BILL OF MATERIALS AND COMPONENTS

**ANCHOR INSTALLATION CHART**

Anchor Manufacturer and Type	Size	Substrate	Edge Distance	Depth of Embedment
ELCO PanelMate® Pro, Plus, TVAS	1/4"	Concrete : 2,500 PSI	2.50"	1.75"
			1.00"	2.00"
			2.50"	2.00"
		CMU: 2,000 PSI	2.00"	1.25"
			3.00"	1.25"
			0.75"	1.875"
Wood: SG 0.42 (non-HVHZ) and 0.55 (HVHZ)	1/4"	2.00"	2.00"	1.50"
			1-1/4"	1"
			2-1/2"	1"
ITW Tapcon Storm Guard (SG)	1/4"	Concrete : 2,500 PSI	1-1/4"	1-3/4"
			2-1/2"	1-3/4"
			1-1/4"	1-1/4"
		CMU: 1,500 PSI	1-1/4"	1-1/4"
			2-1/2"	1-1/4"
			2-1/2"	1-1/4"

POLYGAL INC.  
1100 BOND STREET  
CHARLOTTE, NC 28208

---

POLYGAL SG 16MM CLEAR STORM PANEL  
L.M. IMPACT (HVHZ)  
GENERAL NOTES AND ELEVATION


DRAWN: JRM	DWG NO. NL-0116	REV 1
SCALE NTS	DATE 10/24/18	SHEET 1 OF 6

ROBERT J. AMORUSO  
FL. P.E. NO. 49752


---

Robert J. Amoruso, P.E.  
734 S South Center St.  
Ormond Beach, FL 32174  
rjaengpe@gmail.com  
FBPE FL P.E. No. 49752

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED

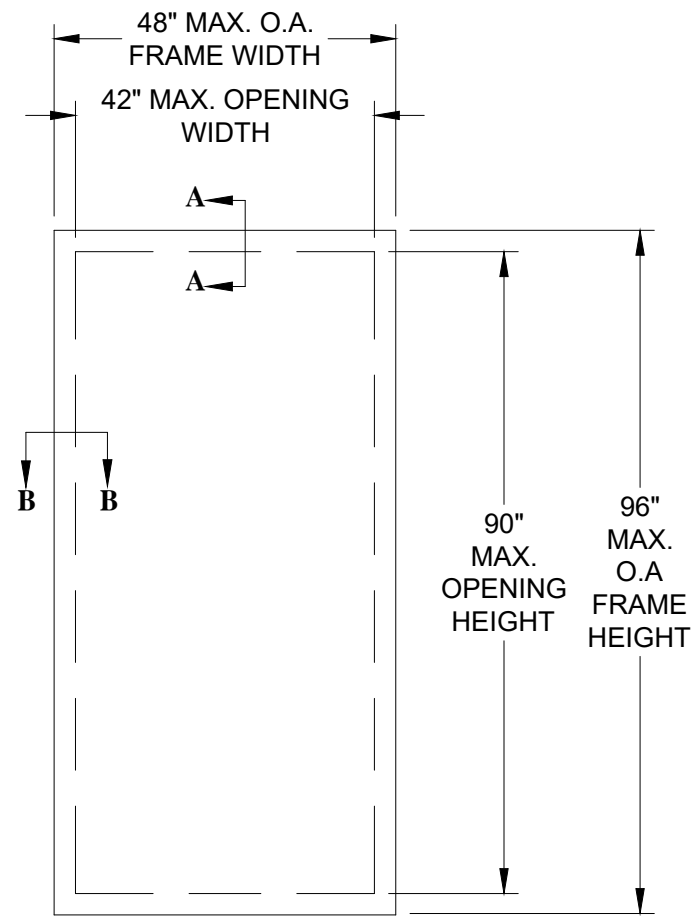

ELEVATION  
POLYGAL SG 16MM  
EXTERIOR VIEW

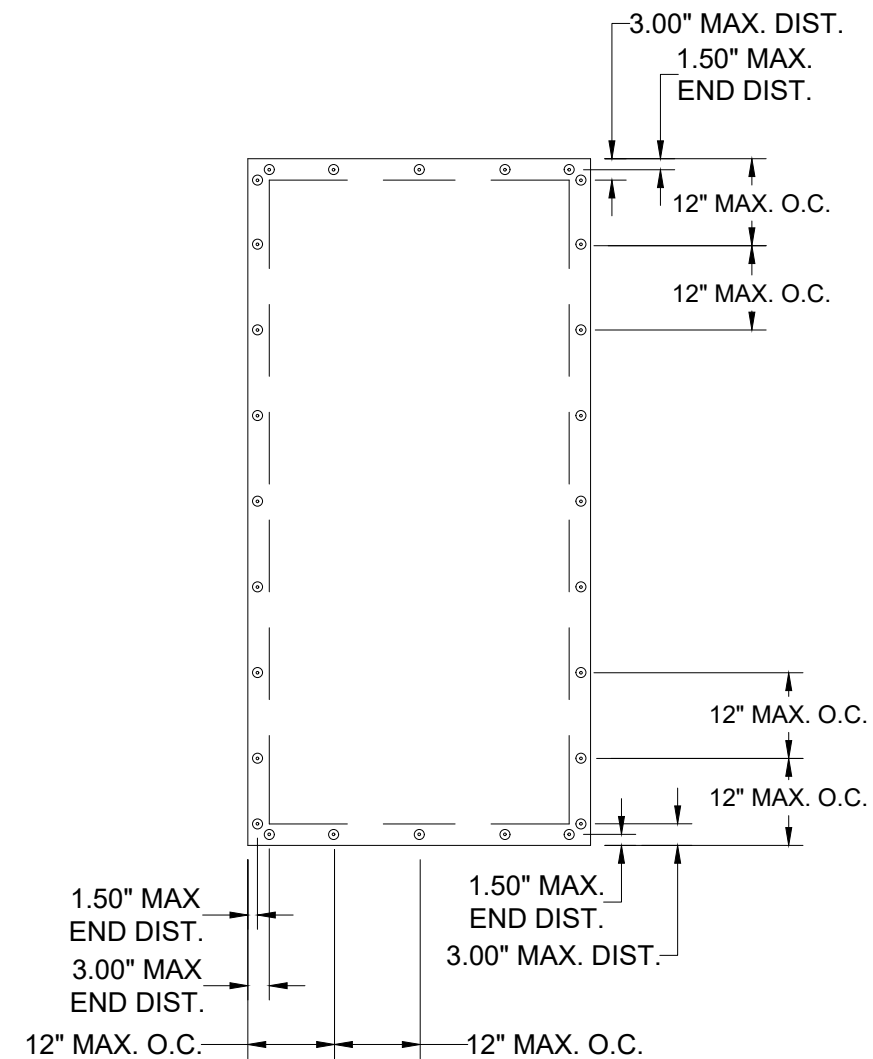

ANCHOR LAYOUT  
INTERIOR VIEW

NOTES  
1. MAXIMUM PANEL SIZE: 48" X 96"

DESIGN PRESSURE RATING	IMPACT RATING
+ 45.0 PSF / -45.0 PSF	LARGE AND SMALL MISSILE IMPACT


MISSILE LEVEL D, WIND ZONE 4 AND HVHZ

POLYGAL INC. 1100 BOND STREET CHARLOTTE, NC 28208		
POLYGAL SG 16MM CLEAR STORM PANEL L.M. IMPACT (HVHZ) ELEVATION AND ANCHOR LAYOUT		
DRAWN: JRM	DWG NO. NL-0116	REV 1
SCALE NTS	DATE 10/24/18	SHEET 2 OF 6


ROBERT J. AMORUSO  
FL. P.E. NO. 49752

Robert J. Amoruso, P.E.  
734 S South Center St.  
Ormond Beach, FL 32174  
rjaengpe@gmail.com  
FBPE FL P.E. No. 49752

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED

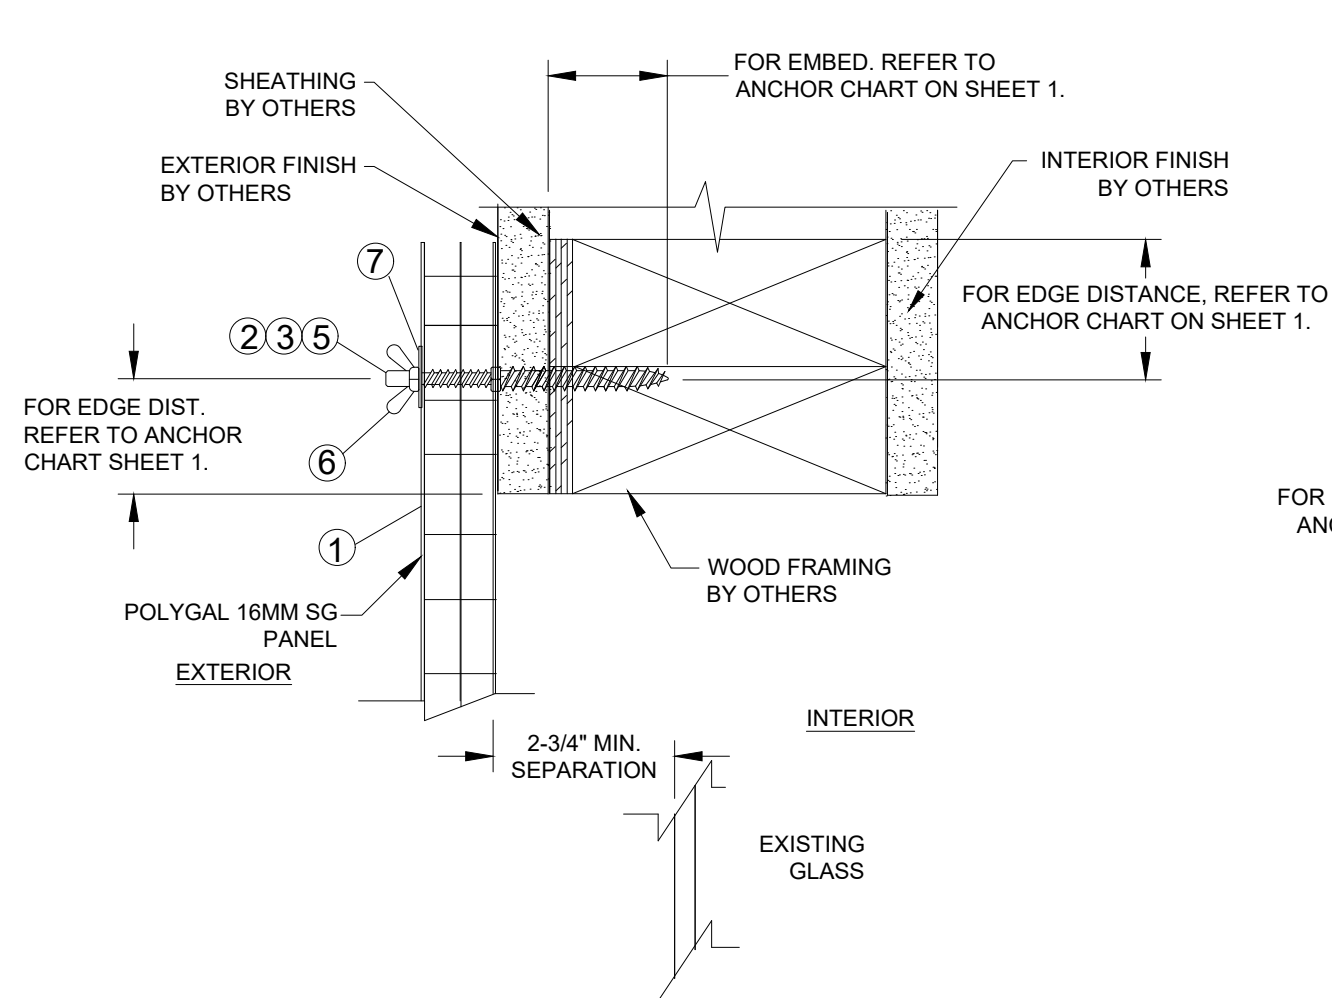

**A**  
**3**  
**VERTICAL SECTION**  
**WOOD FRAME SUBSTRATE**  
**WALL MOUNT INSTALLATION**

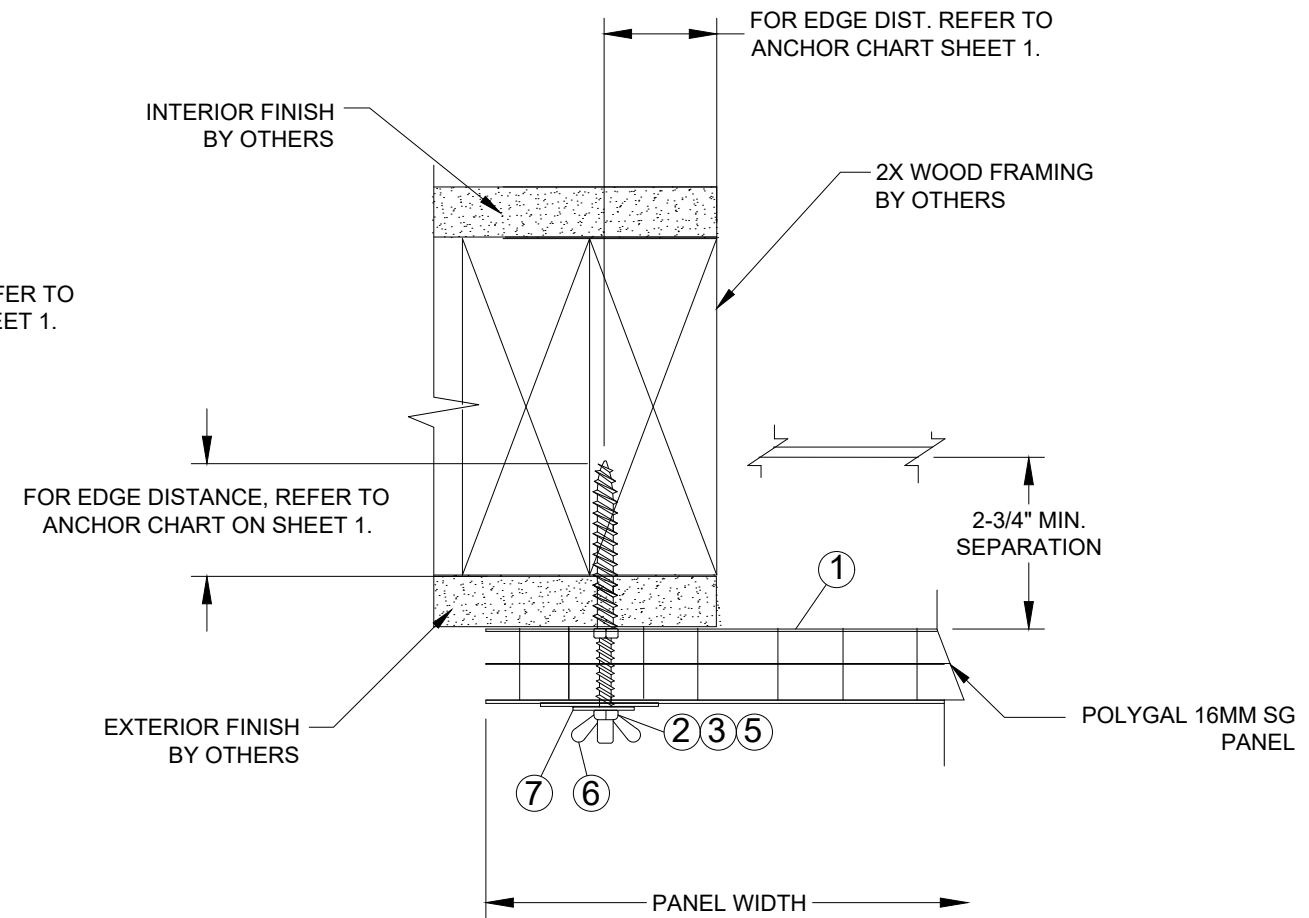


**B**  
**3**  
**HORIZONTAL SECTION**  
**WOOD FRAME SUBSTRATE**  
**WALL MOUNT INSTALLATION**

POLY GAL INC. 1100 BOND STREET CHARLOTTE, NC 28208		
POLY GAL SG 16MM CLEAR STORM PANEL L.M. IMPACT (HVHZ) INSTALLATION DETAILS- WOOD FRAME		
DRAWN: JRM	DWG NO. NL-0116	REV 1
SCALE NTS	DATE 10/24/18	SHEET 3 OF 6


ROBERT J. AMORUSO  
FL. P.E. NO. 49752

Robert J. Amoruso, P.E.  
734 S South Center St.  
Ormond Beach, FL 32174  
rjaengpe@gmail.com  
FBPE FL P.E. No. 49752

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED

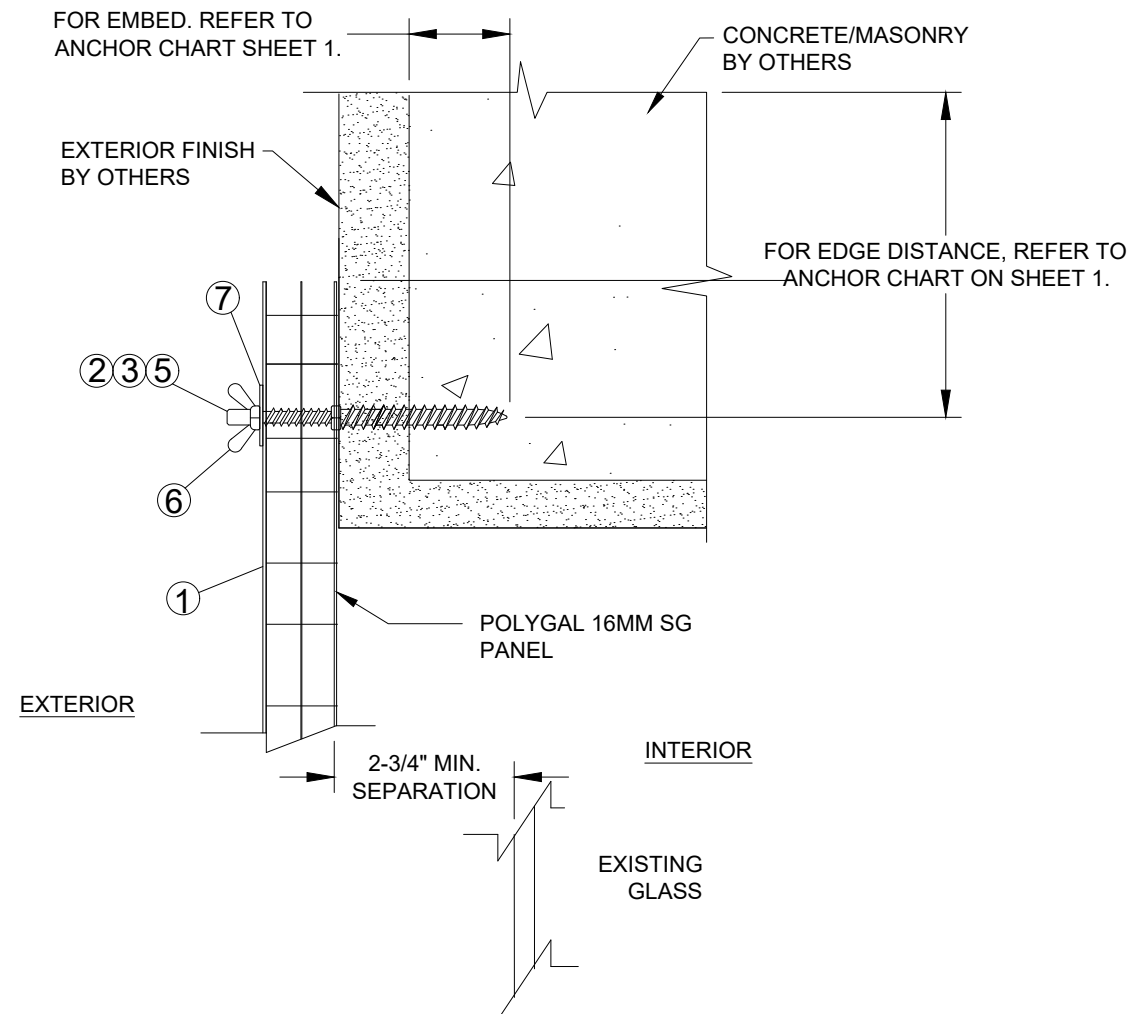

**A**  
**4**  
**VERTICAL SECTION**  
**CONCRETE SUBSTRATE**  
**WALL MOUNT INSTALLATION**

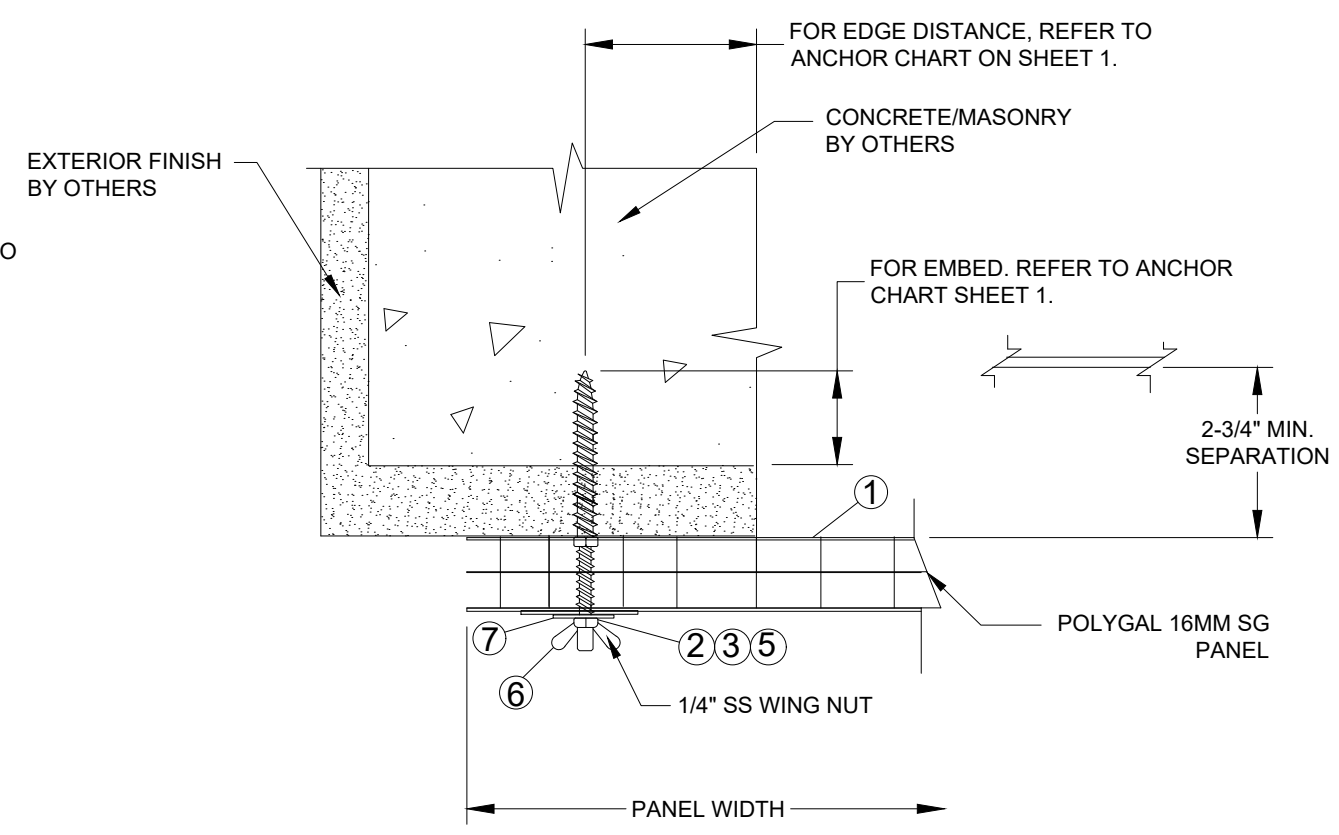


**B**  
**4**  
**HORIZONTAL SECTION**  
**MASONRY/CONCRETE SUBSTRATE**  
**WALL MOUNT INSTALLATION**

POLYGAL INC. 1100 BOND STREET CHARLOTTE, NC 28208		
POLYGAL SG 16MM CLEAR STORM PANEL L.M. IMPACT (HVHZ) INSTALLATION DETAILS- MASONRY/CONC.		
DRAWN: JRM	DWG NO. NL-0116	REV 1
SCALE NTS	DATE 10/24/18	SHEET 4 OF 6


ROBERT J. AMORUSO  
FL. P.E. NO. 49752

Robert J. Amoruso, P.E.  
734 S South Center St.  
Ormond Beach, FL 32174  
rjaengpe@gmail.com  
FBPE FL P.E. No. 49752

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED

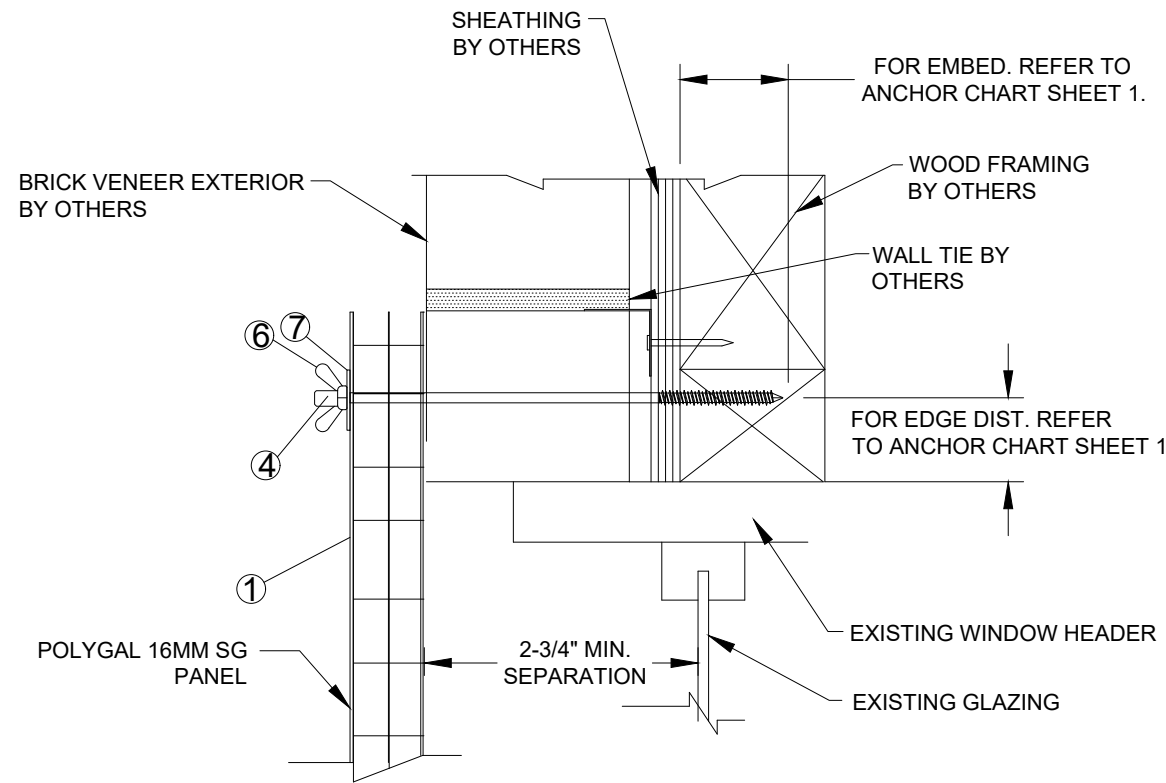

**A**  
**5** **VERTICAL SECTION**  
**SOLID BRICK VENEER ANCHORING**  
**WALL MOUNT INSTALLATION**

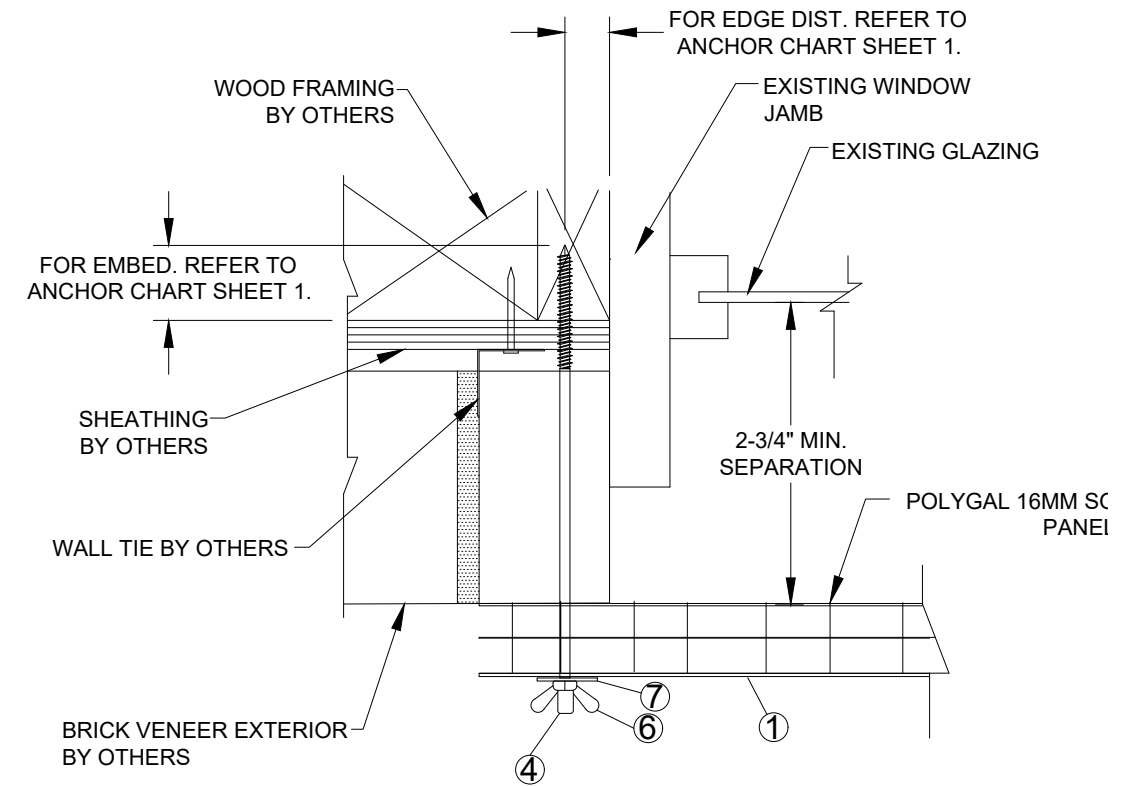

**B**  
**5** **HORIZONTAL SECTION**  
**SOLID BRICK VENEER ANCHORING**  
**WALL MOUNT INSTALLATION**

ROBERT J. AMORUSO  
FL. P.E. NO. 49752

POLYGAL INC.  
1100 BOND STREET  
CHARLOTTE, NC 28208


POLYGAL SG 16MM CLEAR STORM PANEL  
L.M. IMPACT (HVHZ)  
INSTALLATION DETAILS- BRICK VENEER

DRAWN: JRM	DWG NO. NL-0116	REV 1
SCALE NTS	DATE 10/24/18	SHEET 5 OF 6


Robert J. Amoruso, P.E.  
734 S South Center St.  
Ormond Beach, FL 32174  
rjaengpe@gmail.com  
FBPE FL P.E. No. 49752

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED

PART NO.	DESCRIPTION	MANUFACTURER
1	16MM SG, POLYCARBONATE	POLYGAL INC.
2	1/4" PANELMATE PRO	ELCO
3	1/4" PANELMATE PLUS	ELCO
4	1/4" PANELMATE PRO TVAS	ELCO
5	1/4" TAPCON SG	REDHEAD / ITW BUILDEX
6	1/4"-20 WING NUT, MATERIAL SHALL BE COMPATIBLE WITH ANCHOR (PART NO. 2 OR 3)	-----
7	1/4" FLAT WASHER, 1-1/4" O.D., MATERIAL SHALL BE COMPATIBLE WITH ANCHOR (PART NO. 2 OR 3)	-----

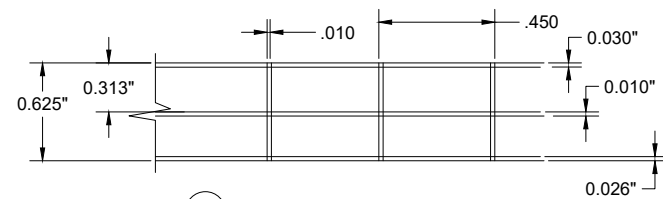


① POLYGAL 16MM PANEL  
CROSS SECTION  
POLYCARBONATE

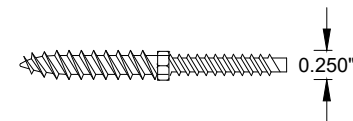


② ③ 1/4" PANELMATE PRO OR PLUS  
⑤ 1/4" TAPCON SG



⑥ 1/4"-20 WING NUT STEEL



⑦ 1/4" WASHER (1/16" THICK)



④ 1/4" PANELMATE TVAS

POLYGAL INC.  
1100 BOND STREET  
CHARLOTTE, NC 28208

POLYGAL SG 16MM CLEAR STORM PANEL  
L.M. IMPACT (HVHZ)  
BILL OF MATERIALS & COMPONENTS

DRAWN: JRM	DWG NO. NL-0116	REV 1
SCALE NTS	DATE 10/24/18	SHEET 6 OF 6

ROBERT J. AMORUSO  
FL. P.E. NO. 49752

Robert J. Amoruso, P.E.  
734 S South Center St.  
Ormond Beach, FL 32174  
rjaengpe@gmail.com  
FBPE FL P.E. No. 49752